


# American Wheatley Fabricated Flow Diverter/Suction Diffuser Pressure Drop Chart vs Flow Rate

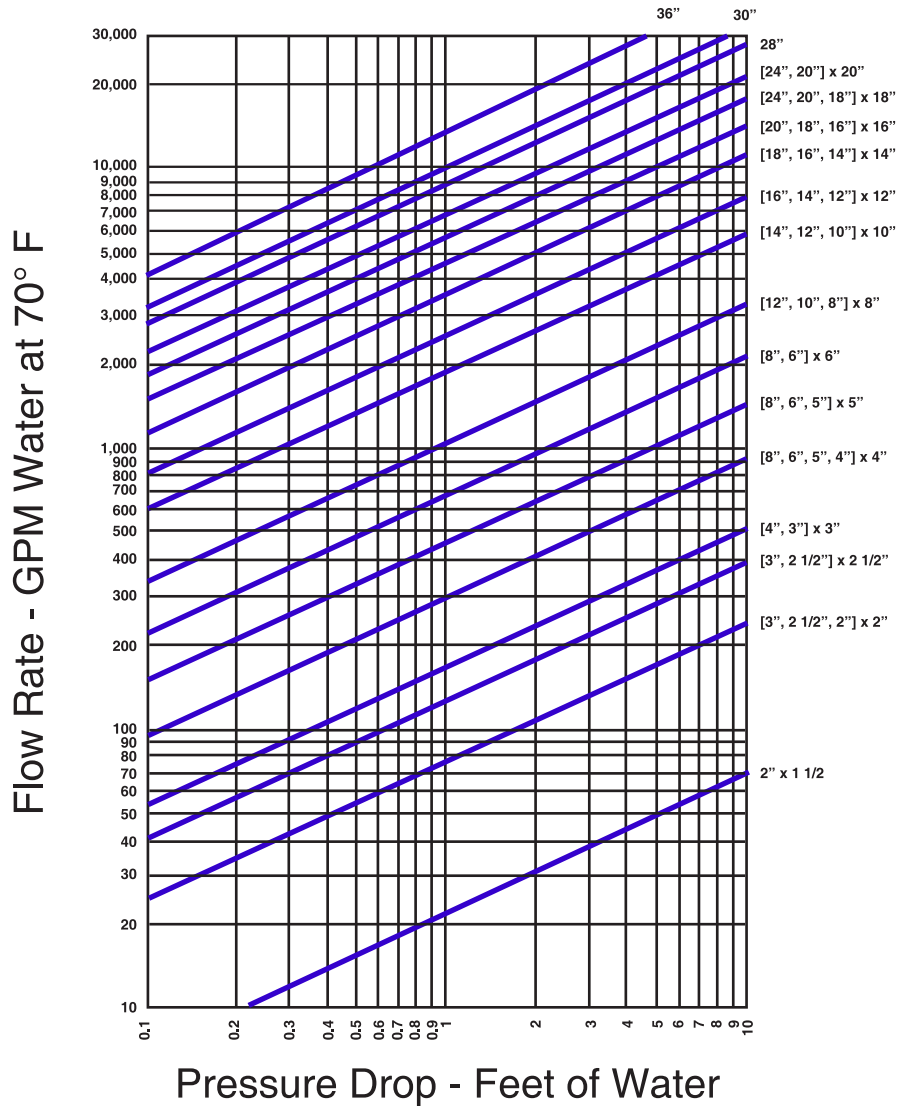

JOB NAME _____ LOCATION _____ _____ CONTRACTOR _____ CONTRACTOR P.O. NO. _____	<table border="1"> <thead> <tr> <th>ITEMS</th> <th>QUANTITY</th> </tr> </thead> <tbody> <tr><td>_____</td><td>_____</td></tr> <tr><td>_____</td><td>_____</td></tr> <tr><td>_____</td><td>_____</td></tr> <tr><td>_____</td><td>_____</td></tr> <tr><td>_____</td><td>_____</td></tr> </tbody> </table>	ITEMS	QUANTITY	_____	_____	_____	_____	_____	_____	_____	_____	_____	_____	<p><b>American WHEATLEY</b> HVAC PRODUCTS® A GFP COMPANY</p> <p>2701 W. Concord Street Broken Arrow, OK 74012 Toll Free: 866-204-5229 PH: 918-317-0401 FAX: 918-317-0407 www.wheatleyhvac.com e-mail: sales@globalflowproducts.com</p>
ITEMS	QUANTITY													
_____	_____													
_____	_____													
_____	_____													
_____	_____													
_____	_____													